

Analoges Ausgangsmodul MR-AO4

1108351302

899293



1. Beschreibung

Das Modbus Modul mit 4 analogen Ausgängen wurde für dezentrale Schaltaufgaben entwickelt. Es ist geeignet als Stellgrößengeber, z.B. elektrische Lüftungs- und Mischklappen, Ventilstellungen usw. Über einen Modbus-Master können die Ausgänge eingestellt werden. Die Adressierung des Moduls sowie die Einstellung der Bitrate und Parität erfolgt über die beiden Adressschalter (x1 / x10) auf der Frontseite. Es können die Adressen 00 bis 99 sowie die Bitraten 1200, 2400, 4800, 9600, 19200, 38400, 57600 und 115200 Bd eingestellt werden.

Bei Adresse 00 nimmt das Gerät nicht an der Bus-Kommunikation teil (reserviert für Broadcast-Adresse).

2. Wichtige Hinweise

Konformitätserklärung

Das Gerät wurde nach den geltenden Normen geprüft. Die Konformität wurde nachgewiesen. Die Konformitätserklärung ist beim Hersteller BTR NETCOM GmbH abrufbar.

Hinweise zur Gerätebeschreibung

Die Beschreibung enthält Hinweise zum Einsatz und zur Montage des Geräts. Sollten Fragen auftreten, die nicht mit Hilfe dieser Anleitung geklärt werden können, sind weitere Informationen beim Lieferanten oder Hersteller einzuholen.

Die angegebenen Vorschriften/Richtlinien zur Installation und Montage gelten für die Bundesrepublik Deutschland. Beim Einsatz des Geräts im Ausland sind die nationalen Vorschriften in Eigenverantwortung des Anlagenbauers oder des Betreibers einzuhalten.

Sicherheitshinweise

Für die Montage und den Einsatz des Geräts sind die jeweils gültigen Arbeitsschutz-, Unfallverhütungs- und VDE-Vorschriften einzuhalten.

Facharbeiter oder Installateure werden darauf hingewiesen, dass sie sich vor der Installation oder Wartung der Geräte vorschriftsmäßig entladen müssen.

Montage- und Installationsarbeiten an den Geräten dürfen grundsätzlich nur durch qualifiziertes Fachpersonal durchgeführt werden, siehe Abschnitt "qualifiziertes Fachpersonal".

Jede Person, die das Gerät einsetzt, muss die Beschreibungen dieser Anleitung gelesen und verstanden haben.

Warnung vor gefährlicher elektrischer Spannung

Gefahr



bedeutet, dass bei Nichtbeachtung Lebensgefahr besteht, schwere Körperverletzungen oder erhebliche Sachschäden auftreten können.

Qualifiziertes Fachpersonal

Qualifiziertes Fachpersonal im Sinne dieser Anleitung sind Personen, die mit den beschriebenen Geräten vertraut sind und über eine ihrer Tätigkeit entsprechenden Qualifikation verfügen.

Hierzu gehören zum Beispiel:

- Berechtigung zum Anschluss des Geräts gemäß den VDE-Bestimmungen und den örtlichen EVU-Vorschriften sowie Berechtigung zum Ein-, Aus- und Freischalten des Geräts unter Berücksichtigung der innerbetrieblichen Vorschriften;
- Kenntnis der Unfallverhütungsvorschriften;
- Kenntnisse über den Einsatz und Gebrauch des Geräts innerhalb des Anlagensystems usw.

3. Technische Daten

Modbus-Schnittstelle

Protokoll	Modbus RTU
Übertragungsrate	1200 ... 115200 Bd (Werkseinstellung 19200 Bd Even)
Verkabelung	RS485 Zweidrahtbus mit Potentialausgleich in Bus-/Linientopologie

Versorgung

Betriebsspannungsbereich	20 ... 28 V AC/DC (SELV)
Stromaufnahme	50 mA (AC) / 20 mA (DC)
Einschaltdauer relativ	100 %

Ausgangsseite

Ausgangsspannung	4 x 0 ... 10 V DC
Ausgangsstrom	5 mA bei 10 V DC
Auflösung	0,625 mV / Digit
Fehler	100 mV

Gehäuse

Abmessungen BxHxT	35 x 70 x 65 mm
Gewicht	72 g
Einbaulage	beliebig
Montage	Tragschiene TH35 nach IEC 60715
Anreihbar ohne Abstand	Nach dem Anreihen von 15 Modulen oder einer maximalen Stromaufnahme von 2 A (AC oder DC) pro Anschluss am Netzgerät muss mit der Versorgungsspannung neu extern angefahren werden.

Material

Gehäuse	Polyamid 6.6 V0
Klemmen	Polyamid 6.6 V0
Blende	Polycarbonat

Schutzart (IEC 60529)

Gehäuse	IP40
Klemmen	IP20

Anschlussklemmen

Versorgung und Bus	
4-polige Anschlussklemme	max. 1,5 mm ² eindrähtig max. 1,0 mm ² feinstdrähtig
Aderndurchmesser	0,3 mm bis max. 1,4 mm (Anschlussklemme und Brückenstecker als Zubehör in der Verpackung)

Geräteanschluss

Eingänge	max. 4 mm ² eindrähtig max. 2,5 mm ² feinstdrähtig
Aderndurchmesser	0,3 mm bis max. 2,7 mm


Temperaturbereich

Betrieb	-5 °C ... +55 °C
Lagerung	-20 °C ... +70 °C
Schutzbeschaltung	Verpolschutz der Betriebsspannung Verpolschutz von Speisung und Bus


Anzeige

Betrieb und Bustätigkeit	grüne LED
Fehlermeldung	rote LED

4. Prinzipbild



5. Anschlussbild



6. Montage


Anlage spannungsfrei schalten

Gerät auf Tragschiene (TH35 nach IEC 60715, Einbau in Elektroverteiler / Schalttafel) setzen


Installation

Die Elektroinstallation und der Geräteanschluss dürfen nur durch qualifiziertes Fachpersonal unter Beachtung der VDE-Bestimmungen und örtlicher Vorschriften vorgenommen werden..


Anschlussklemme für Busanschluss einstecken.

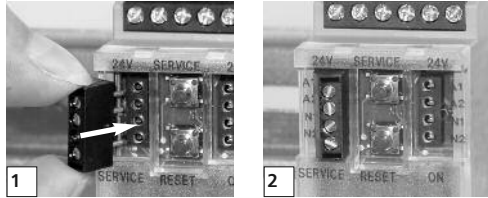

Kabel für Busanschluss anschließen

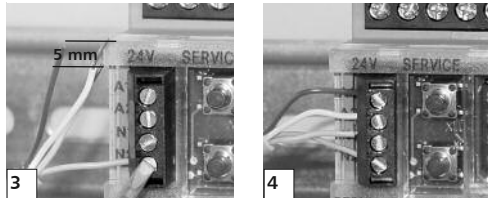

Reihenmontage

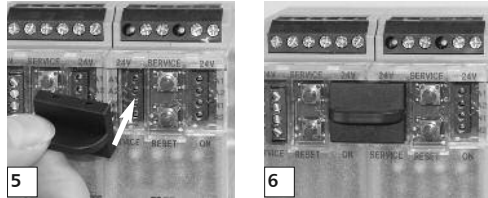

Das Modul ist ohne Abstand anreihbar. Bei Reihenmontage Brückenstecker aufstecken, er verbindet Bus und Versorgungsspannung bei nebeneinander montierten Modulen.


Nach dem Anreihen von 15 Modulen oder einer maximalen Stromaufnahme von 2 A (AC oder DC) pro Anschluss am Netzgerät muss mit der Versorgungsspannung neu extern angefahren werden.

7. Bitrate und Parität einstellen

Die Bitrate und Parität kann im Programmiermodus eingestellt werden, bei dem eine Steckbrücke hinter der Frontblende des Moduls gesteckt ist. Diese Steckbrücke ist im Normalbetrieb entfernt. Eine Verbindung mit dem Bus ist dazu nicht nötig.

Die Bitrate der Module kann folgendermaßen eingestellt werden:

1. Die Frontblende des Moduls entfernen;
2. auf die beiden mittleren Stifte der 4-poligen Stiftleiste zwischen roter und grüner LED eine Steckbrücke stecken (2);
3. die gewünschte Parität und Bitrate gemäß untenstehender Tabelle an den Adressschaltern (3) einstellen;

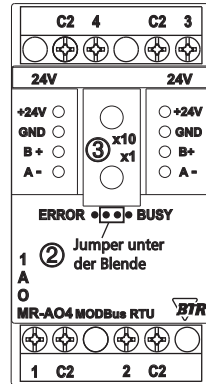

4. die Versorgungsspannung des Moduls einschalten; das Modul speichert die Bitrate jetzt dauerhaft in einem EEPROM;
5. die Versorgungsspannung des Moduls wieder ausschalten;
6. die Steckbrücke von der Stiftleiste entfernen und die Frontblende montieren.

Schalter x10	0	1	2					
Parity	even	odd	none					
Schalter x1	0	1	2	3	4	5	6	7
Bitrate (Bit/s)	1200	2400	4800	9600	19200	38400	57600	115200

Weichen die Einstellungen von denen in der Tabelle angegebenen ab, gilt die Werkseinstellung.
Werkseinstellung: 19200 Bd Even

9. Beschreibung der Software

9.1 I/O Kommandos

"03 (0x03) Read Holding Registers"

Request	
Valid Starting Address	0 .. 3
Valid Quantity of Outputs	1 .. 4
Response	
Byte Count	2, 4, 6, 8
Register Values	0x0000 to 0xFFFF (7FFF = 10,24 Volt)
Einheit = $10,24V / 2^{15} = 1V / 3200 = 0,3125 \text{ mV}$	

"06 (0x06) Write Single Register"

Request	
Valid Output Address	0 .. 3
Valid Output Value	0x0000 to 0xFFFF (7FFF = 10,24 Volt)
Einheit = $10,24V / 2^{15} = 1V / 3200 = 0,3125 \text{ mV}$	
Response	
Echo of the request	

"16 (0x10) Write Multiple Registers"

Request	
Valid Starting Address	0 .. 3
Valid Quantity of Outputs	1 .. 4
Valid Byte Count	2, 4, 6, 8
Valid Output Value	0x0000 to 0xFFFF (7FFF = 10,24 Volt)
Einheit = $10,24V / 2^{15} = 1V / 3200 = 0,3125 \text{ mV}$	
Response	
Function Code, Starting Adress, Quantity of Registers	

9.2 Bitrate einstellen über Modbus-Kommando

Parität und Bitrate haben die gleichen Werte wie bei der Einstellung über die Adressschalter.

Wenn Parity oder Baud 0 ist, erfolgt keine Einstellung und Speicherung.

Der Registerinhalt wird im EEPROM gespeichert.

"06 (0x06) Write Single Register"

Request															
Valid Register Address	0x41 (65)														
Valid Register Value	2 Bytes														
15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
0x53								Parität				Bitrate			

Bit 15-8: Magic-Number 0x53 = 83 zum Schutz vor versehentlichem Schreiben. Nur mit dieser Nummer wird das Kommando weiter ausgewertet.

Bit 7-4	1	2	3				
Parität	even	odd	none				
Bit 3-0	1	2	3	4	5	6	7
Bitrate	1200	2400	4800	9600	19200	38400	57600

Response	
Echo of Request	

Fortsetzung Beschreibung der Software

Beispiel für einen Frame:

Slave-Adresse	0x12	Dreheschalter-Einstellung (18)
Funktion	0x06	Write Single Register
Register-Adresse Hi	0x00	
Register-Adresse Lo	0x41	Bitrate und Parität (65)
Register-Inhalt Hi	0x53	Magic-Number
Register-Inhalt Lo	0x15	Parity Even, 19200 Baud

Alle Geräte können mit einem Broadcast-Kommando (Slave-Adresse 0x00) gleichzeitig umgeschaltet werden. Davon wird aber abgeraten, weil es zu Problemen führen kann:

- Geräte von anderen Herstellern haben an dieser Adresse eventuell ein Register für einen anderen Zweck, das dann falsch bedient wird.
- Es gibt keine Rückmeldung von den einzelnen Geräten. Die Steuerung kann also nicht sofort erkennen, ob das Kommando richtig angekommen ist.

Sicherer ist es, jedes Gerät einzeln anzusprechen und umzuschalten. Das Gerät antwortet dann noch mit der alten Einstellung von Parität und Bitrate. Erst danach wird umgeschaltet. Die Antwort kann bei gestörtem Bus allerdings verloren gehen.

Nach dem Umschalten aller Geräte sollte die Kommunikation überprüft werden. Dazu ist jede Funktion der Geräte geeignet, die eine Rückmeldung liefert. Wenn dafür eine einheitliche Funktion verwendet werden soll, die unabhängig von der Prozess-Peripherie ist, eignet sich die Funktion "Diagnostic", Subfunktion "Return Query Data", die die gesendeten Daten zurück schickt.

Wenn bei einem Gerät nicht bekannt ist, welche Bitrate und Parität eingestellt ist, kann man es nacheinander mit allen Kombinationen von Bitrate und Parität ansprechen, bis es antwortet. Die wahrscheinlichsten Kombinationen sollten dabei zuerst probiert werden. Die niedrigeren Bitraten sollten zuletzt probiert werden, weil sie länger dauern.

Fortsetzung Beschreibung der Software

9.3 Allgemeine Kommandos

"08 (0x08) Diagnostics"

Subfunction "0 (0x0000) Return Query Data"

Data Field Any

Response: Echo of Request

Subfunction "1 (0x0001) Restart Communication Option"

Data Field 0x0000 oder 0xFF00

Response: Echo of Request

Action: Clears all Error Counters, Restarts node

Subfunction "4 (0x0004) Force Listen Only Mode"

Data Field 0x0000

No Response

Action: No response until Node Reset or Function Code 08 Subcode 01

Subfunction "10 (0x000A) Clear Counters"

Data Field 0x0000

Response: Echo of Request

Action: Clears all Error Counters

Subfunction "11 (0x000B) Return Bus Message Count"

Data Field 0x0000

Response: Quantity of messages that the remote device has detected on the communications system since its last restart, clear counters operation, or power-up.

Subfunction "12 (0x000C) Return Bus Communication Error Count"

Data Field 0x0000

Response: Quantity of errors encountered by the remote device since its last restart, clear counters operation, or power-up. (CRC, Length <3, Parity, Framing)

Subfunction "13 (0x000D) Return Bus Exception Error Count"

Data Field 0x0000

Response: Quantity of MODBUS exception responses returned by the remote device since its last restart, clear counters operation, or power-up.

Subfunction "14 (0x000E) Return Slave Message Count"

Data Field 0x0000

Response: quantity of messages addressed to the remote device, or broadcast, that the remote device has processed since its last restart, clear counters operation, or power-up.

Subfunction "15 (0x000F) Return Slave No Response Count"

Data Field 0x0000

Response: Quantity of messages addressed to the remote device for which it has returned no response (neither a normal response nor an exception response), since its last restart, clear counters operation, or power-up.

Fortsetzung Beschreibung der Software

"43 /14 (0x2B / 0x0E) Read Device Identification"

Request

Read Device ID code:	0x01
Object ID	0x00

Response:

Device ID code	0x01
Conformity level	0x01
More follows	0x00
Next object ID	0x00
Number of objects	0x03
Object ID	0x00
Object Length	0x03
Object Value	"BTR"
Object ID	0x01
Object Length	0x06
Object Value	"MR-AO4"
Object ID	0x02
Object Length	0x04
Object Value	"V1.0"

Analog Output Module MR-AO4

1108351302

899293



1. Description

The Modbus module with 4 analog outputs is designed for local switching operations. It is suitable as variable encoder, for example ventilation or mixing valves, valve positions etc. The outputs can be adjusted via a Modbus-Master. Addressing of the module as well as bit rate and parity setting are done with the two address switches (x1 / x10) on the front. Possible settings are addresses 00 to 99 and bit rates 1200, 2400, 4800, 9600, 19200, 38400, 57600 und 115200 Bd.

The device does not participate in bus communication if the address is 00 (reserved for broadcast address).

2. Declaration of Conformity

The device was tested according to the applicable standards. Conformity was proofed. The declaration of conformity is available at the manufacturer BTR NETCOM GmbH.

Notes Regarding Device Description

These instructions include indications for use and mounting of the device. In case of questions that cannot be answered with these instructions please consult supplier or manufacturer.

The indicated installation directions or rules are applicable to the Federal Republic of Germany. If the device is used in other countries it applies to the equipment installer or the user to meet the national directions.

Safety Instructions

Keep the applicable directions for industrial safety and prevention of accidents as well as the VDE rules.

Technicians and/or installers are informed that they have to electrically discharge themselves as prescribed before installation or maintenance of the devices.

Only qualified personnel shall do mounting and installation work with the devices, see section "qualified personnel".

The information of these instructions have to be read and understood by every person using this device.

Symbols

Warning of dangerous electrical voltage

Danger

means that non-observance may cause risk of life, grievous bodily harm or heavy material damage.

Qualified Personnel

Qualified personnel in the sense of these instructions are persons who are well versed in the use and installation of such devices and whose professional qualification meets the requirements of their work.

This includes for example:

- Qualification to connect the device according to the VDE specifications and the local regulations and a qualification to put this device into operation, to power it down or to activate it by respecting the internal directions.
- Knowledge of safety rules.
- Knowledge about application and use of the device within the equipment system etc.

3. Technical Data

Modbus Interface

Protocol	Modbus RTU
Transmission rate	1200 ... 115200 Bd (factory setting 19200 Bd Even)
Cabling	RS485 two wire bus with voltage equalizing cable in bus / line topology

Supply

Operating voltage range	20 ... 28 V AC/DC (SELV)
Current consumption	50 mA (AC) / 20 mA (DC)
Relative duty cycle	100 %

Output

Output voltage	4 x 0 ... 10 V DC
Output current	5 mA at 10 V DC
Resolution	0.625 mV / Digit
Error	100 mV

Housing

Dimensions WxHxD	1.4 x 2.8 x 2.6 in. (35 x 70 x 65 mm)
Weight	72 g
Mounting position	any
Mounting	standard rail TH35 per IEC 60715
Mounting in series without space	the maximum quantity of modules connected in line is limited to 15 or to a maximum power consumption of 2 Amps (AC or DC) per connection to the power supply. For any similar block of additional modules a separate connection to the power supply is mandatory.

Material

Housing	Polyamide 6.6 V0
Terminal blocks	Polyamide 6.6 V0
Cover plate	Polycarbonate

Type of protection (IEC 60529)

Housing	IP40
Terminal blocks	IP20

Terminal blocks

Supply and bus	4 pole terminal block	max. AWG 16 (1,5 mm ²) solid wire max. AWG 18 (1,0 mm ²) stranded wire min. 0.3 mm up to max. 1.4 mm (terminal block and jumper plug are included to each packing unit)
Wire diameter		

Module connection

Input/Output	max. AWG 12 (4.0 mm ²) solid wire max. AWG 14 (2.5 mm ²) stranded wire min. 0.3 mm up to max 2.7 mm
Wire diameter	


Temperature range

Operation	-5 °C ... +55 °C
Storage	-20 °C ... +70 °C
Protective circuitry	polarity reversal protection of operating voltage polarity reversal protection of supply and bus

Display


Operating and bus activity	green LED
Error indication	red LED

4. Wiring Diagram

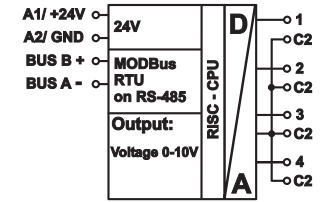

A2 = C2 = GND

5. Connection Diagram



6. Mounting


Power down the equipment

Mount the module on standard rail (TH35 per IEC 60715 in junction boxes and/or on distribution panels).


Installation

Electric installation and device termination shall be done by qualified persons only, by respecting all applicable specifications and regulations.


Plug in the terminal block for bus connection

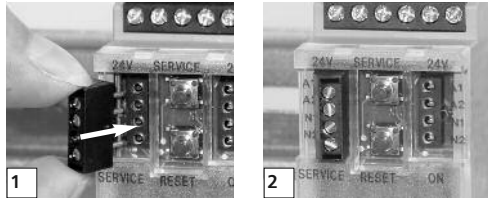

Connect the cable for bus supply

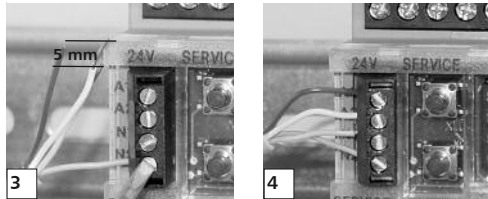

Mounting in series

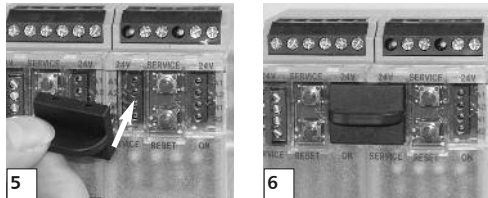

The module can be aligned without interspace. Use the jumper plug to connect bus and supply voltage when the modules are mounted in series.


The maximum quantity of modules connected in line is limited to 15 or to a maximum power consumption of 2 Amps (AC or DC) per connection to the power supply. For any similar block of additional modules a separate connection to the power supply is mandatory.

7. Bit rate and Parity setting

The bit rate and parity can be set in the programming mode when a jumper is plugged behind the front cover of the module. This jumper is removed in normal mode. A connection to the bus is not required during bit rate setting.

The bit rate of the modules can be set in the following way:

- remove the front cover of the module;
- plug a jumper to the two middle pins of the 4 pole header between the red and green LED (2);
- set the desired parity and bit rate with the address switches (3) in accordance to the chart below.

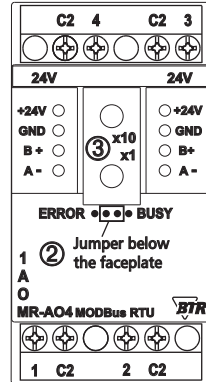

- switch on the supply voltage of the module; it is now permanently saving the bit rate in an EEPROM;
- switch off the supply voltage of the module;
- remove the jumper from the header and place the front cover.

Switch x10	0	1	2					
Parity	even	odd	none					
Switch x1	0	1	2	3	4	5	6	7
Bitrate (Bit/s)	1200	2400	4800	9600	19200	38400	57600	115200

If the settings differ from the settings specified in the chart the factory setting applies.

Factory setting: 19200 Bd Even

9. Software description

9.1 I/O Commands

"03 (0x03) Read Holding Registers"

Request

Valid Starting Address 0 .. 3
Valid Quantity of Outputs 1 .. 4

Response

Byte Count 2, 4, 6, 8
Register Values 0x0000 to 0xFFFF
(7FFF = 10,24 Volt)

Unit = $10,24V / 2^{15} = 1V / 3200 = 0,3125 \text{ mV}$

"06 (0x06) Write Single Register"

Request

Valid Output Address 0 .. 3
Valid Output Value 0x0000 to 0xFFFF
(7FFF = 10,24 Volt)

Unit = $10,24V / 2^{15} = 1V / 3200 = 0,3125 \text{ mV}$

Response

Echo of the request

"16 (0x10) Write Multiple Registers"

Request

Valid Starting Address 0 .. 3
Valid Quantity of Outputs 1 .. 4
Valid Byte Count 2, 4, 6, 8
Valid Output Value 0x0000 to 0xFFFF
(7FFF = 10,24 Volt)

Unit = $10,24V / 2^{15} = 1V / 3200 = 0,3125 \text{ mV}$

Response

Function Code, Starting Address, Quantity of Registers

9.2 Bit rate setting with Modbus command

Parity and bit rate have the same value as when setting them by address switch.

If Parity or Bit has the value 0, no setting or storage is carried out. The register content is stored in the EEPROM.

"06 (0x06) Write Single Register"

Request

Valid Register Address 0x41 (65)
Valid Register Value 2 Bytes

15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
0x53						Parity			Bit rate						

Bit 15-8: Magic-Number 0x53 = 83 as protection against accidental writing.

The command will be further analysed only with this number.

Bit 7-4	1	2	3												
Parity	even	odd	none												
Bit 3-0	1	2	3	4	5	6	7	8							
Bit rate	1200	2400	4800	9600	19200	38400	57600	115200							

Response

Echo of Request

Example for a frame:

Slave address	0x12	Setting of rotary switch (18)
Function	0x06	Write Single Register
Register address Hi	0x00	
Register address Lo	0x41	Bit rate and parity (65)
Register contents Hi	0x53	Magic-Number
Register contents Lo	0x15	Parity Even, 19200 Baud

All devices can be switched simultaneously with a Broadcast command (Slave address 0x00) However, it is advised not to do so as this can cause problems:

- Devices from other manufacturers may have under this address a register for a different purpose that will then be operated in the wrong way.
- There is no feedback from the individual devices. Consequently the control cannot immediately recognize if the command was correctly received.

It is safer to address and switch each device individually.

The device will then answer with the old settings of parity and bit rate. Switching will take place only afterwards. However, the answer can get lost if the bus is disturbed.

When all devices are switched; it is advised to check communication. Any function of the device providing a feedback is suitable. If a single function is to be used being independent from the process periphery then the function „Diagnostic“ sub-function „Return Query Data“ is suitable, it returns the transferred data.

If bit rate and parity setting of a device are unknown it is possible to address the device successively with all combinations of bit rate and parity until the device answers. Try the most likely combinations first. Try the lower bit rates last as they take longer.

Continuation Software description

9.3 General Commands

"08 (0x08) Diagnostics"

Subfunction "0 (0x0000) Return Query Data"

Data Field Any

Response: Echo of Request

Subfunction "1 (0x0001) Restart Communication Option"

Data Field 0x0000 oder 0xFF00

Response: Echo of Request

Action: Clears all Error Counters, Restarts node

Subfunction "4 (0x0004) Force Listen Only Mode"

Data Field 0x0000

No Response

Action: No response until Node Reset or Function Code 08

Subcode 01

Subfunction "10 (0x000A) Clear Counters"

Data Field 0x0000

Response: Echo of Request

Action: Clears all Error Counters

Subfunction "11 (0x000B) Return Bus Message Count"

Data Field 0x0000

Response: Quantity of messages that the remote device has detected on the communications system since its last restart, clear counters operation, or power-up.

Subfunction "12 (0x000C) Return Bus Communication Error Count"

Data Field 0x0000

Response: Quantity of errors encountered by the remote device since its last restart, clear counters operation, or power-up. (CRC, Length <3, Parity, Framing)

Subfunction "13 (0x000D) Return Bus Exception Error Count"

Data Field 0x0000

Response: Quantity of MODBUS exception responses returned by the remote device since its last restart, clear counters operation, or power-up.

Subfunction "14 (0x000E) Return Slave Message Count"

Data Field 0x0000

Response: quantity of messages addressed to the remote device, or broadcast, that the remote device has processed since its last restart, clear counters operation, or power-up.

Subfunction "15 (0x000F) Return Slave No Response Count"

Data Field 0x0000

Response: Quantity of messages addressed to the remote device for which it has returned no response (neither a normal response nor an exception response), since its last restart, clear counters operation, or power-up.

"43 /14 (0x2B / 0x0E) Read Device Identification"

Request

Read Device ID code: 0x01

Object ID 0x00

Response:

Device ID code 0x01

Conformity level 0x01

More follows 0x00

Next object ID 0x00

Number of objects 0x03

Object ID 0x00

Object Length 0x03

Object Value "BTR"

Object ID 0x01

Object Length 0x06

Object Value "MR-A04"

Object ID 0x02

Object Length 0x04

Object Value "V1.0"